

Next Curb Installation Instructions

All electrical installation work must be carried out by an authorised installer and comply with the installation requirements in the country of use.

Cables and wiring installed in the cable duct must have at least double insulation and be type-approved and specifically intended for this installation method. The manufacturer's mounting and installation instructions must be followed.

The unit is intended for use within the scope of the Low Voltage Directive, i.e., up to 1000 V AC and 1500 V DC.






The asphalt is dried

prior to installation

The pieces are placed in position

ready for installation

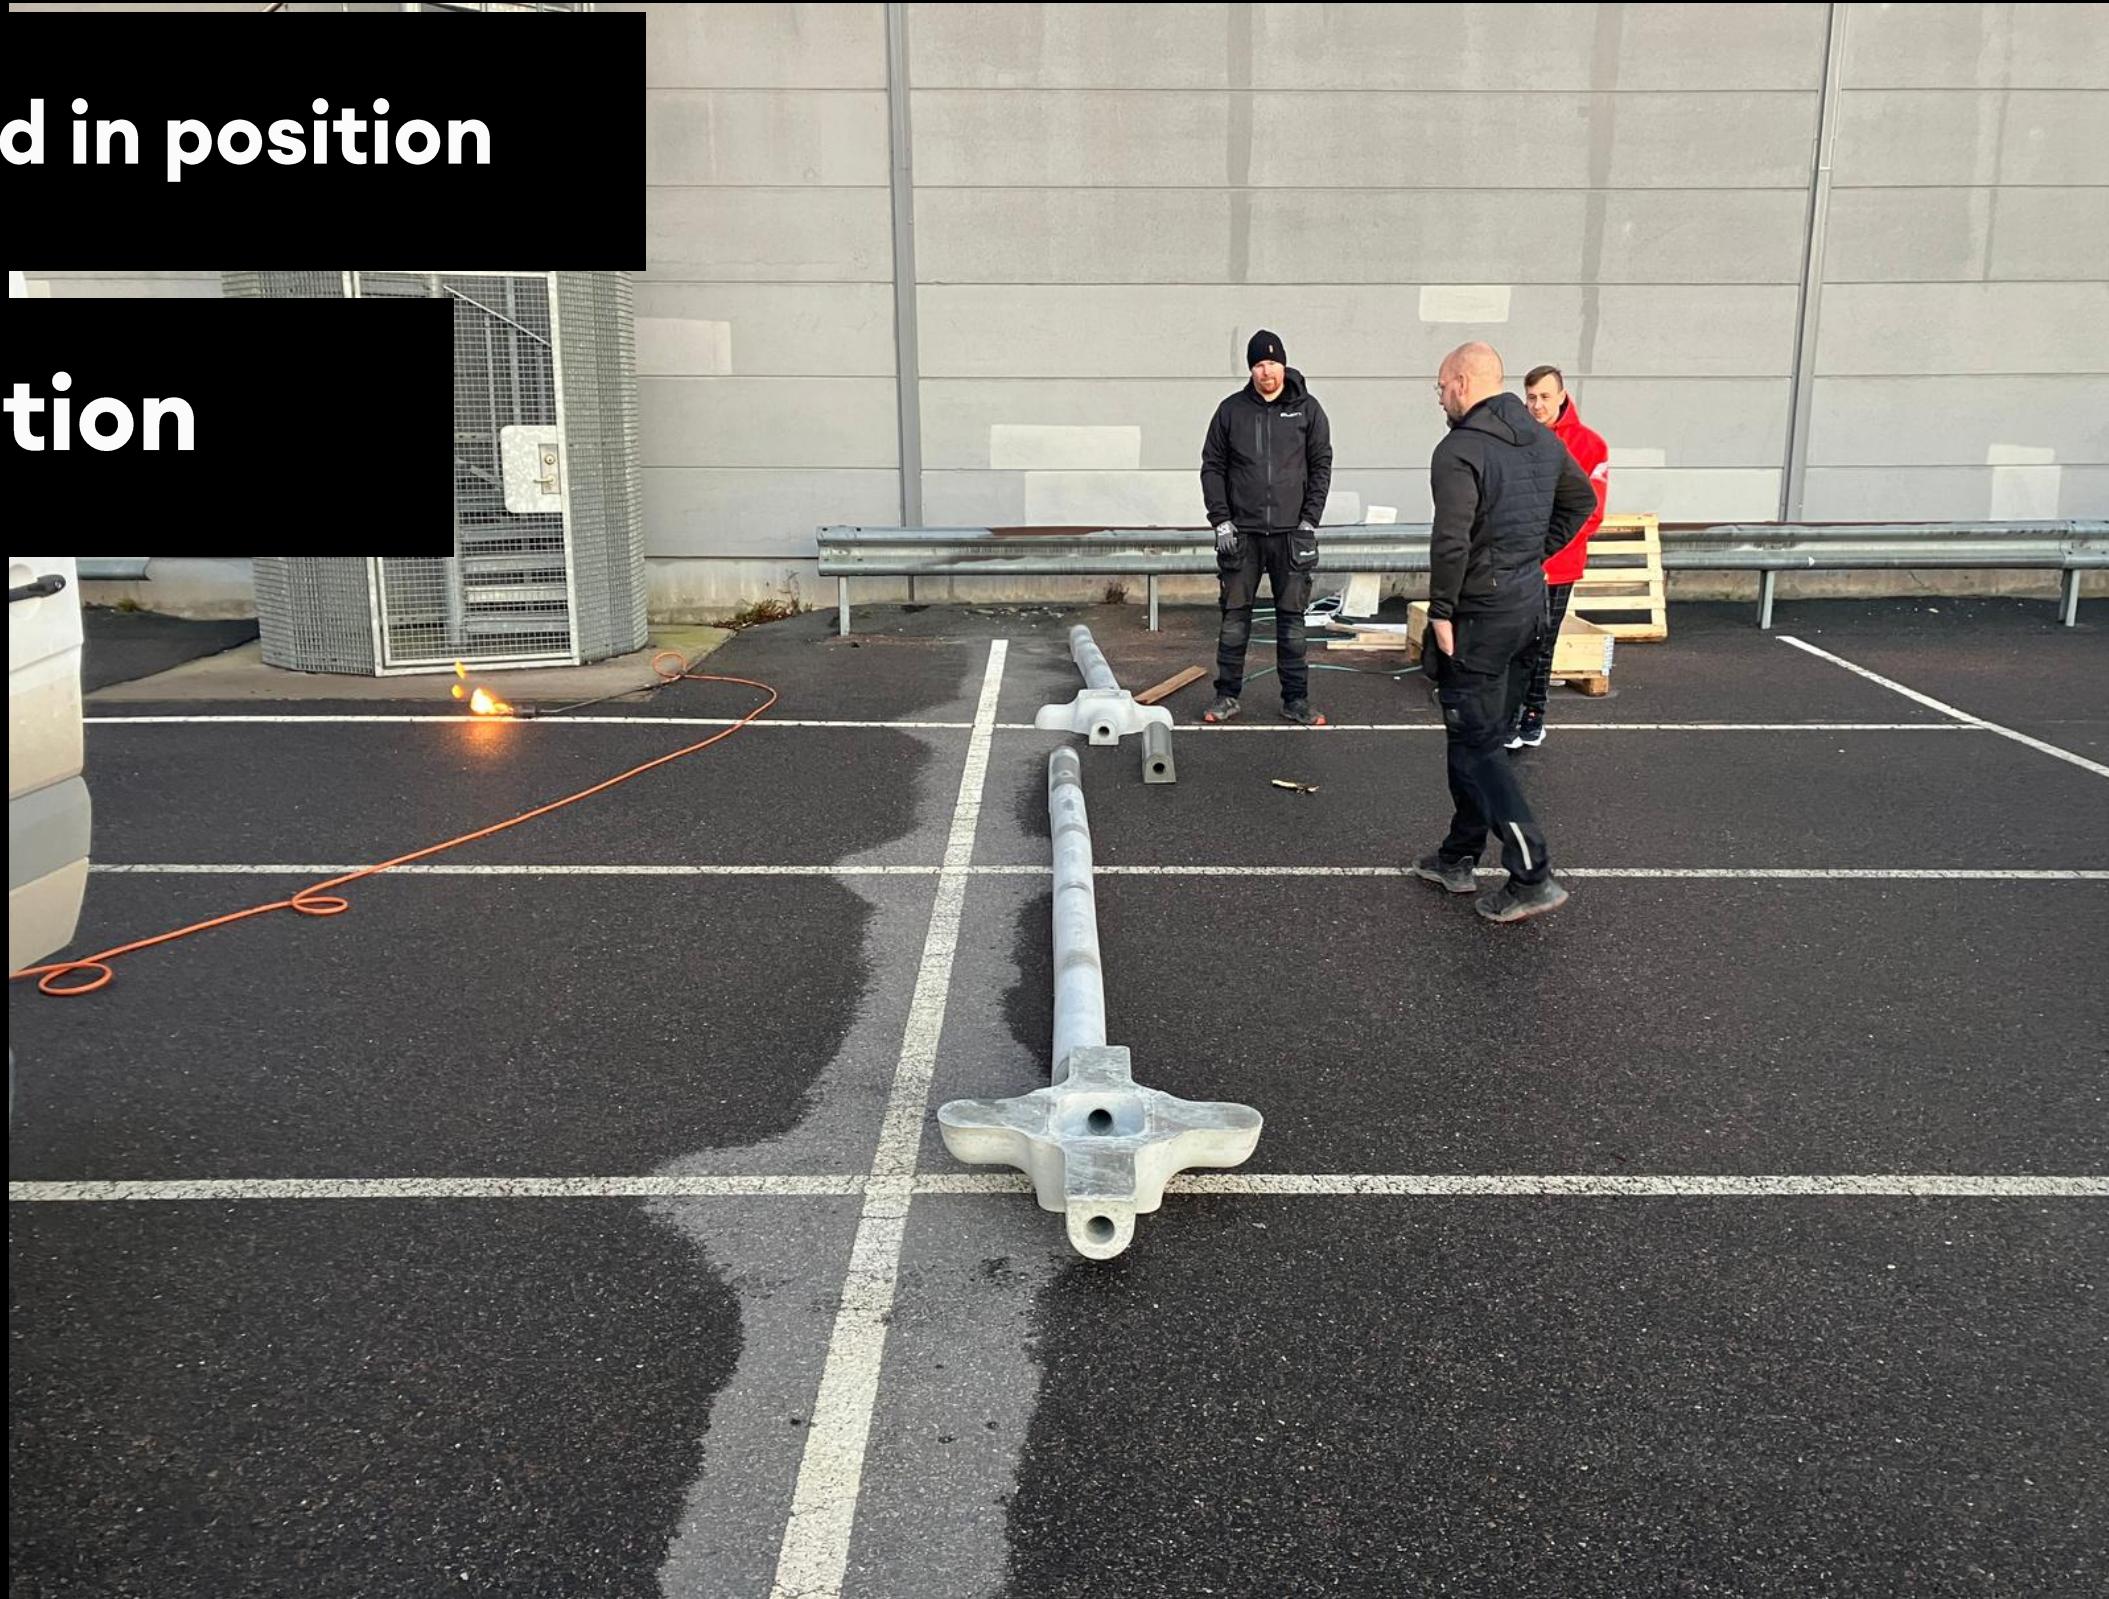



The adhesive is heat-treated



**Each stone is placed
and secured one by one**



The stones can easily be cut

**to fit the dimensions of
the parking area**

Time to install the pedestal
and chargers



